
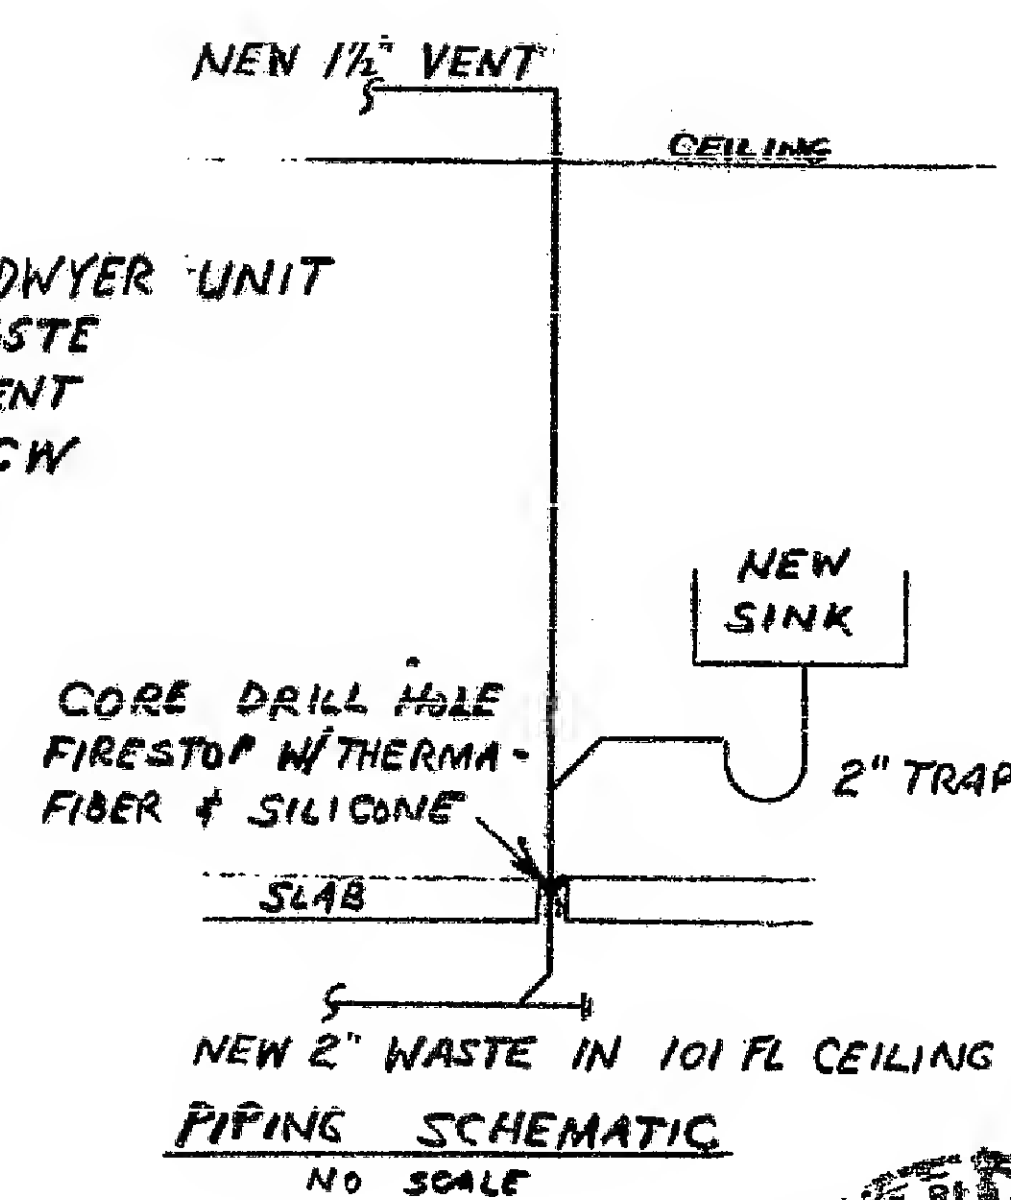


PLUMBING NOTES

1. WATER PIPING SHALL BE TYPE TP COPPER W/BRAZED JOINTS
2. WASTE & VENT PIPING SHALL BE NO-HUB
3. UTILIZE EXIST'G VALVES FOR NEW INSTALLATION.

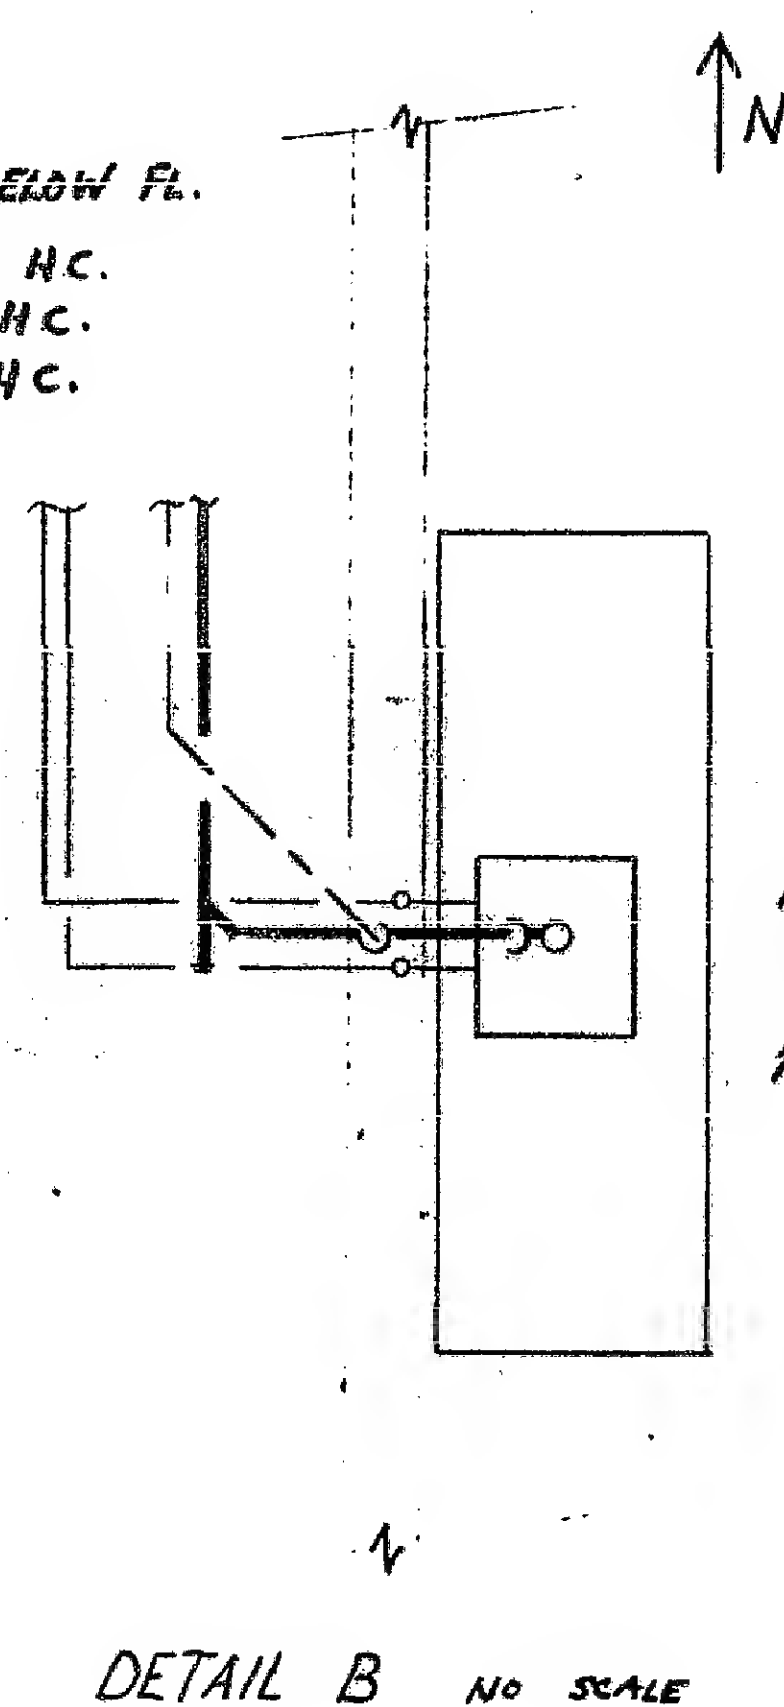

## LEGEND &amp; SYMBOLS

	EXIST. DOUBLE ROUGH - REMOVE
	EXIST. SINGLE ROUGH - REMOVE
	NEW DUCTWORK
	EXIST DUCTWORK
	EXIST DUCTWORK - REMOVE
	EXIST FULL CAPACITY INDUCTION UNIT
	RELOCATED 1 1/2 CAP INDUCTION UNIT
	EXIST 1 1/2 CAP INDUCTION UNIT
	NEW CEILING DIFFUSER
	NEW CEILING GRILL
	EXIST EXHAUST FAN - REMOVE
	RELOCATED THERMOSTAT
	EXIST MOTORIZED DAMPER
	NO. OF CFM - BALANCE
	GATE VALVE
	REDUCER
	STRAINER
	UNION
	PRESSURE GAGE
	THERMOMETER
	PLUG VALVE
	WATER REGULATING VALVE
	CHECK VALVE

INTRADESIGN GROUP INC  
170 FIFTH AVE N.Y. N.Y.

MECHANICAL LEGEND & DETAIL

TOLERATE SYSTEMS INC  
ONE WORLD TRADE CENTER

